

# DES-4122<sup>Q&As</sup>

Specialist - Implementation Engineer PowerEdge Version 2.0

## Pass EMC DES-4122 Exam with 100% Guarantee

Free Download Real Questions & Answers **PDF** and **VCE** file from:

<https://www.pass2lead.com/des-4122.html>

100% Passing Guarantee  
100% Money Back Assurance

Following Questions and Answers are all new published by EMC  
Official Exam Center

- ⚙️ **Instant Download** After Purchase
- ⚙️ **100% Money Back** Guarantee
- ⚙️ **365 Days** Free Update
- ⚙️ **800,000+** Satisfied Customers



### QUESTION 1

An engineer is checking a newly delivered Dell EMC PowerEdge R640 server that will be deployed for a new database environment

The inventory consists of:

- 1 PowerEdge R640 Server
- 1 Hot-plug Power Supply, 750W - qty 1
- Jumper Cord - C13/C14, 4M, 250V, 10A - qty 1
- Broadcom 57412 Dual Port 10GbE SFP+ and 5720 Dual Port 1GbE BASE-T rNDC - qty 1
- SFP+ SR Optic, 10GbE - qty 2
- Dell Networking, Cable, SFP+ to SFP+, 10GbE, Copper Twinax DAC, 3 Meter - qty 2
- CAT6 Patch cable 5 Meters - qty 2

The server power configuration will be set for gnd redundancy The management switch is 1000 Base-T and the top of rack switches 10Gb

What additional component(s) is needed for this configuration?


- A. Hot-plug power supply, 750 W - qty 1
- B. Hot-plug power supply, 1100W - qty 1
- C. Dell Networking, cable, 40GbE (QSFP+) to 4 x 10GbE SFP+ passive copper breakout cable, 3 meters - qty 2
- D. C20 to C21, PDU style, 250 V, 16 Amp, 3 5 meters power cord - qty 2

Correct Answer: D

### QUESTION 2

CORRECT TEXT

A system engineer has a 14G Dell EMC Poweredge server with an amber light blinking. The engineer must pull a SupportAssist collection before calling Dell Support to evaluate what the potential problem. Use the simulator to collect and view the SupportAssist collection.

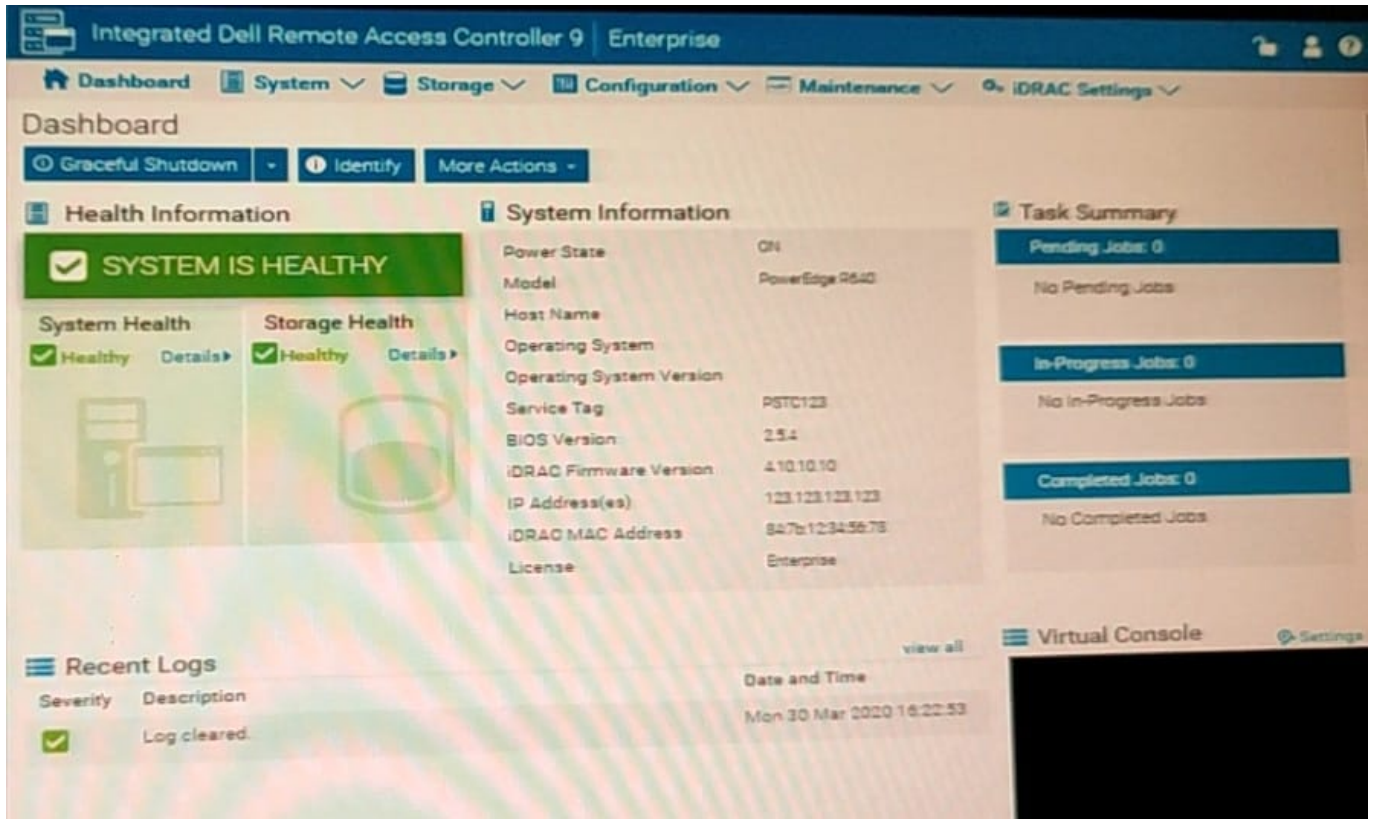


- A. No answer
- B. Place Holder
- C. Place Holder
- D. Place Holder

Correct Answer: A

### QUESTION 3

#### CORRECT TEXT

You are Investigating a disk error on a Dell EMC PowerEdge server and discover a Hot Spare has not been assigned to the Virtual Disk Group. Use the simulator to assign the Global Hot Spare. When you have finished using the simulator, click Next.

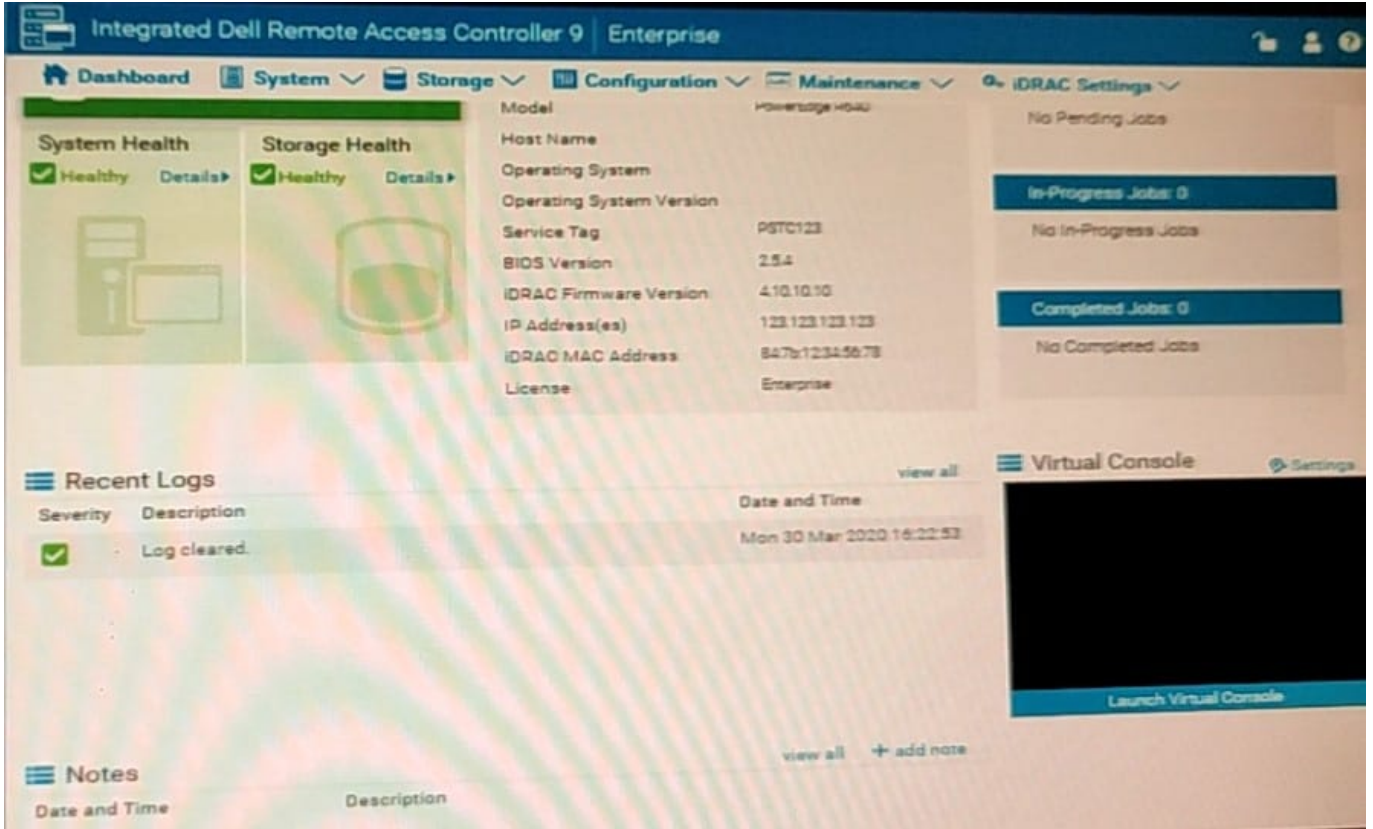

- A. No answer
- B. Place Holder
- C. Place Holder
- D. Place Holder


Correct Answer: A

**QUESTION 4**


DRAG DROP

What is the correct order of steps taken during the BIOS/UEFI Recovery process?

Select and Place:

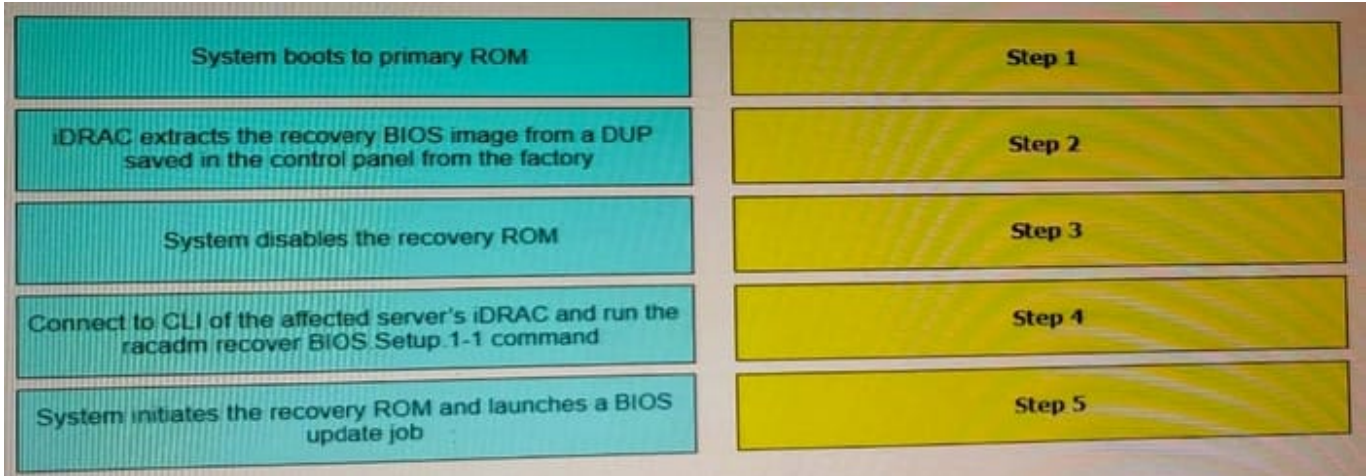

Correct Answer:

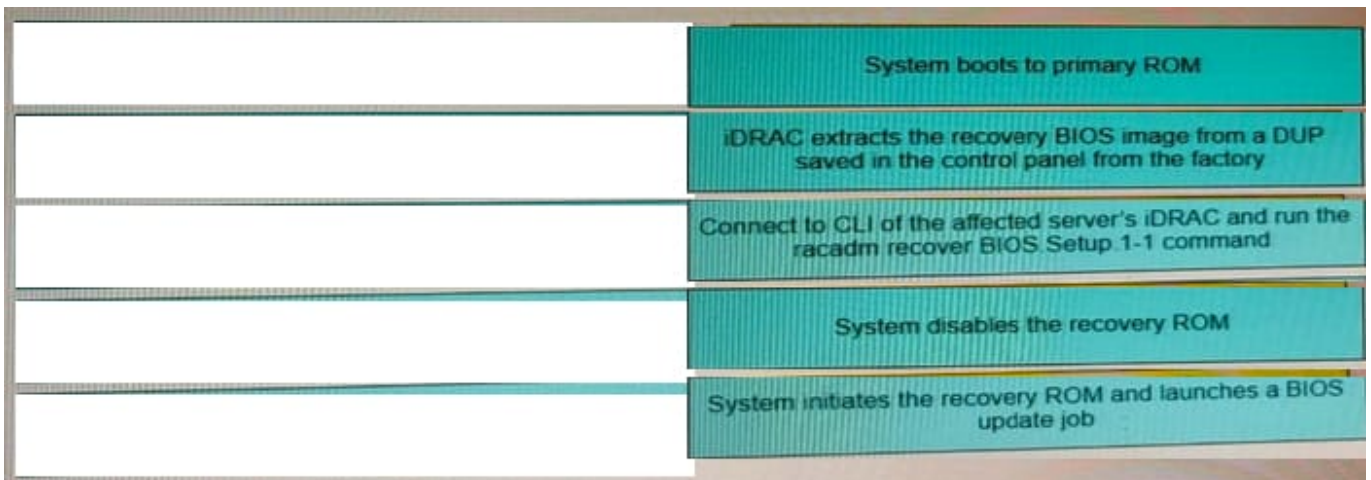

**QUESTION 5**

What is the purpose of the Silicon-Based Hardware Root of Trust feature in Dell EMC PowerEdge 14G servers?

- A. Ensures that the installed operating system is authentic
- B. Ensures that the server has a valid Service Tag number
- C. Ensures that no unauthorized BIOS or firmware codes are run
- D. Ensures that the server boots only when connected to a verified network

Correct Answer: C

[DES-4122 VCE Dumps](#)

[DES-4122 Exam Questions](#)

[DES-4122 Braindumps](#)